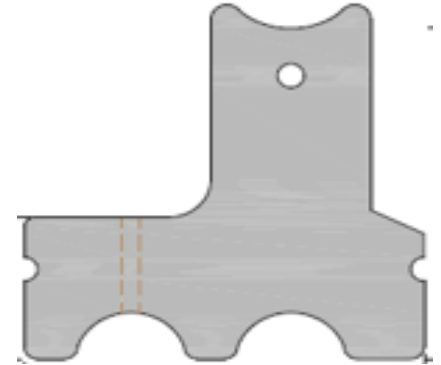


Manufacturer: Quick Bauprodukte GmbH
Test requirements: Test instruction fibre concrete "Norwegian Standard"
Material / Mixture-No.: Quick fiber concrete M1
Concrete quality: C45/55
Exposure class concrete: acc. to Eurocode 2 (EC2) X0 / XC4 / XD 3 / XF4 / XA2

Article / Article-No.: Mounting-Bipo 75 without wire / 22041
Concrete cover: 75 mm
Production date: 02.03.2022
Test period: 19.04.-22.04.2022


Results dimension test

Part No.	H	Vippediagonal
1	74,0	80,0
2	74,0	80,0
3	74,0	80,0
mean	74,0	80,0

Results water absorption test

Part No.	Storage weight in g after 48 hours heat treatment curing at +105°C	Weight in g after 30 min. immersion	Water content in % after 30 min. (to be < 5 %)	Weight in g after 24 hours immersion	Water content in % after 24 hours (to be < 8,5 %)
1	178	182	2,2%	189	6,2%
2	185	190	2,7%	199	7,6%
3	182	186	2,2%	193	6,0%
mean			2,4%		6,6%

Results breaking load test

Part No.	breaking load F / kN (to be >6 kN)
1	7,1
2	7,3
3	6,9
mean	7,1

This certificate complies to the requirements of DIN / EN 10204:2005-01-3.1

The buyer is not released from any entry control.
 It is also irrelevant in case of incorrect use or handling.